

PREFIX (ADD WHEN APPROPRIATE):

A. Campus Projects

- E** - Panel or equipment backed up by generator or battery inverter, e.g. ERP-1050

B. Hospital and Health Care Projects

- C** - Critical Branch, as defined by N.E.C. 517, e.g. CRP-1050
- E** - Equipment System, as defined by N.E.C. 517, e.g. ERP-1050
- L** - Life Safety Branch, as defined by N.E.C. 517, e.g. LRP-1050

ELECTRICAL PANELS:

A. Panel Type


- DP** - Distribution Panel (panel primarily feeding other panels)
- IPS** - Interruptible Power Supply (battery inverter)
- LP** - Lighting Panel (typically a 480/277V panel feeding lighting)
- MCC** - Motor Control Center
- PP** - Power Panel (panel primarily feeding loads directly)
- RP** - Receptacle Panel (typically a 208/120V panel feeding receptacles)
- UPS** - Uninterruptable Power Supply

B. Add the Substation Number - If more than 1 substation exists

C. Insert a hyphen and identify the room number

D. Insert a hyphen and add sequence # if there is more than one of that type Panel/MCC in a room

Example:

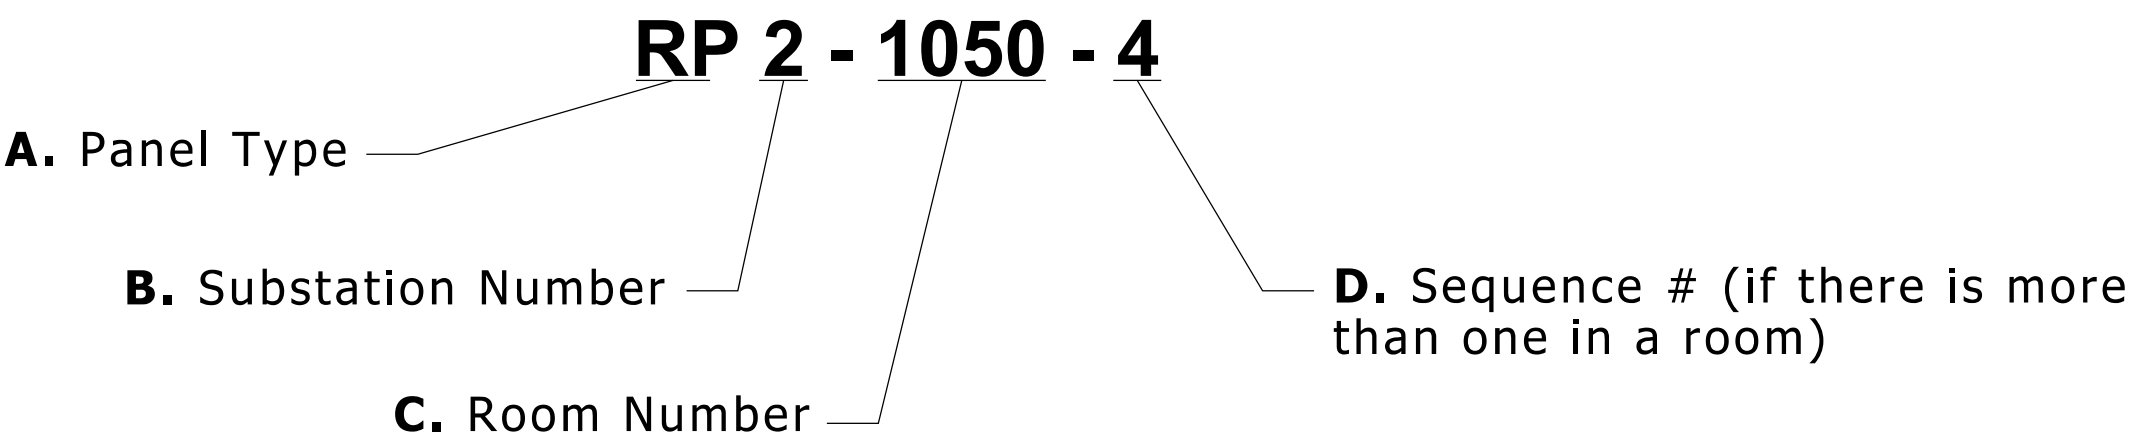

ELECTRICAL EQUIPMENT:

Transformers:

- T** - (Location Room #), e.g. **T-380**. If more than one transformer in room, add sequence # after room #, e.g. T-380-1

Disconnects (Safety Switches):

- A. Fused: DF** - (Location Room #), e.g., **DF-380**. If more than one in room, add sequence #, e.g. **DF-380-1**.
- B. Non-Fused: D** - (Location Room #), e.g. **D-380**. If more than one in room, add sequence #, e.g. **D-380-2**.

**STANDARD PROCEDURE
FOR PANEL & EQUIPMENT NAMING**