


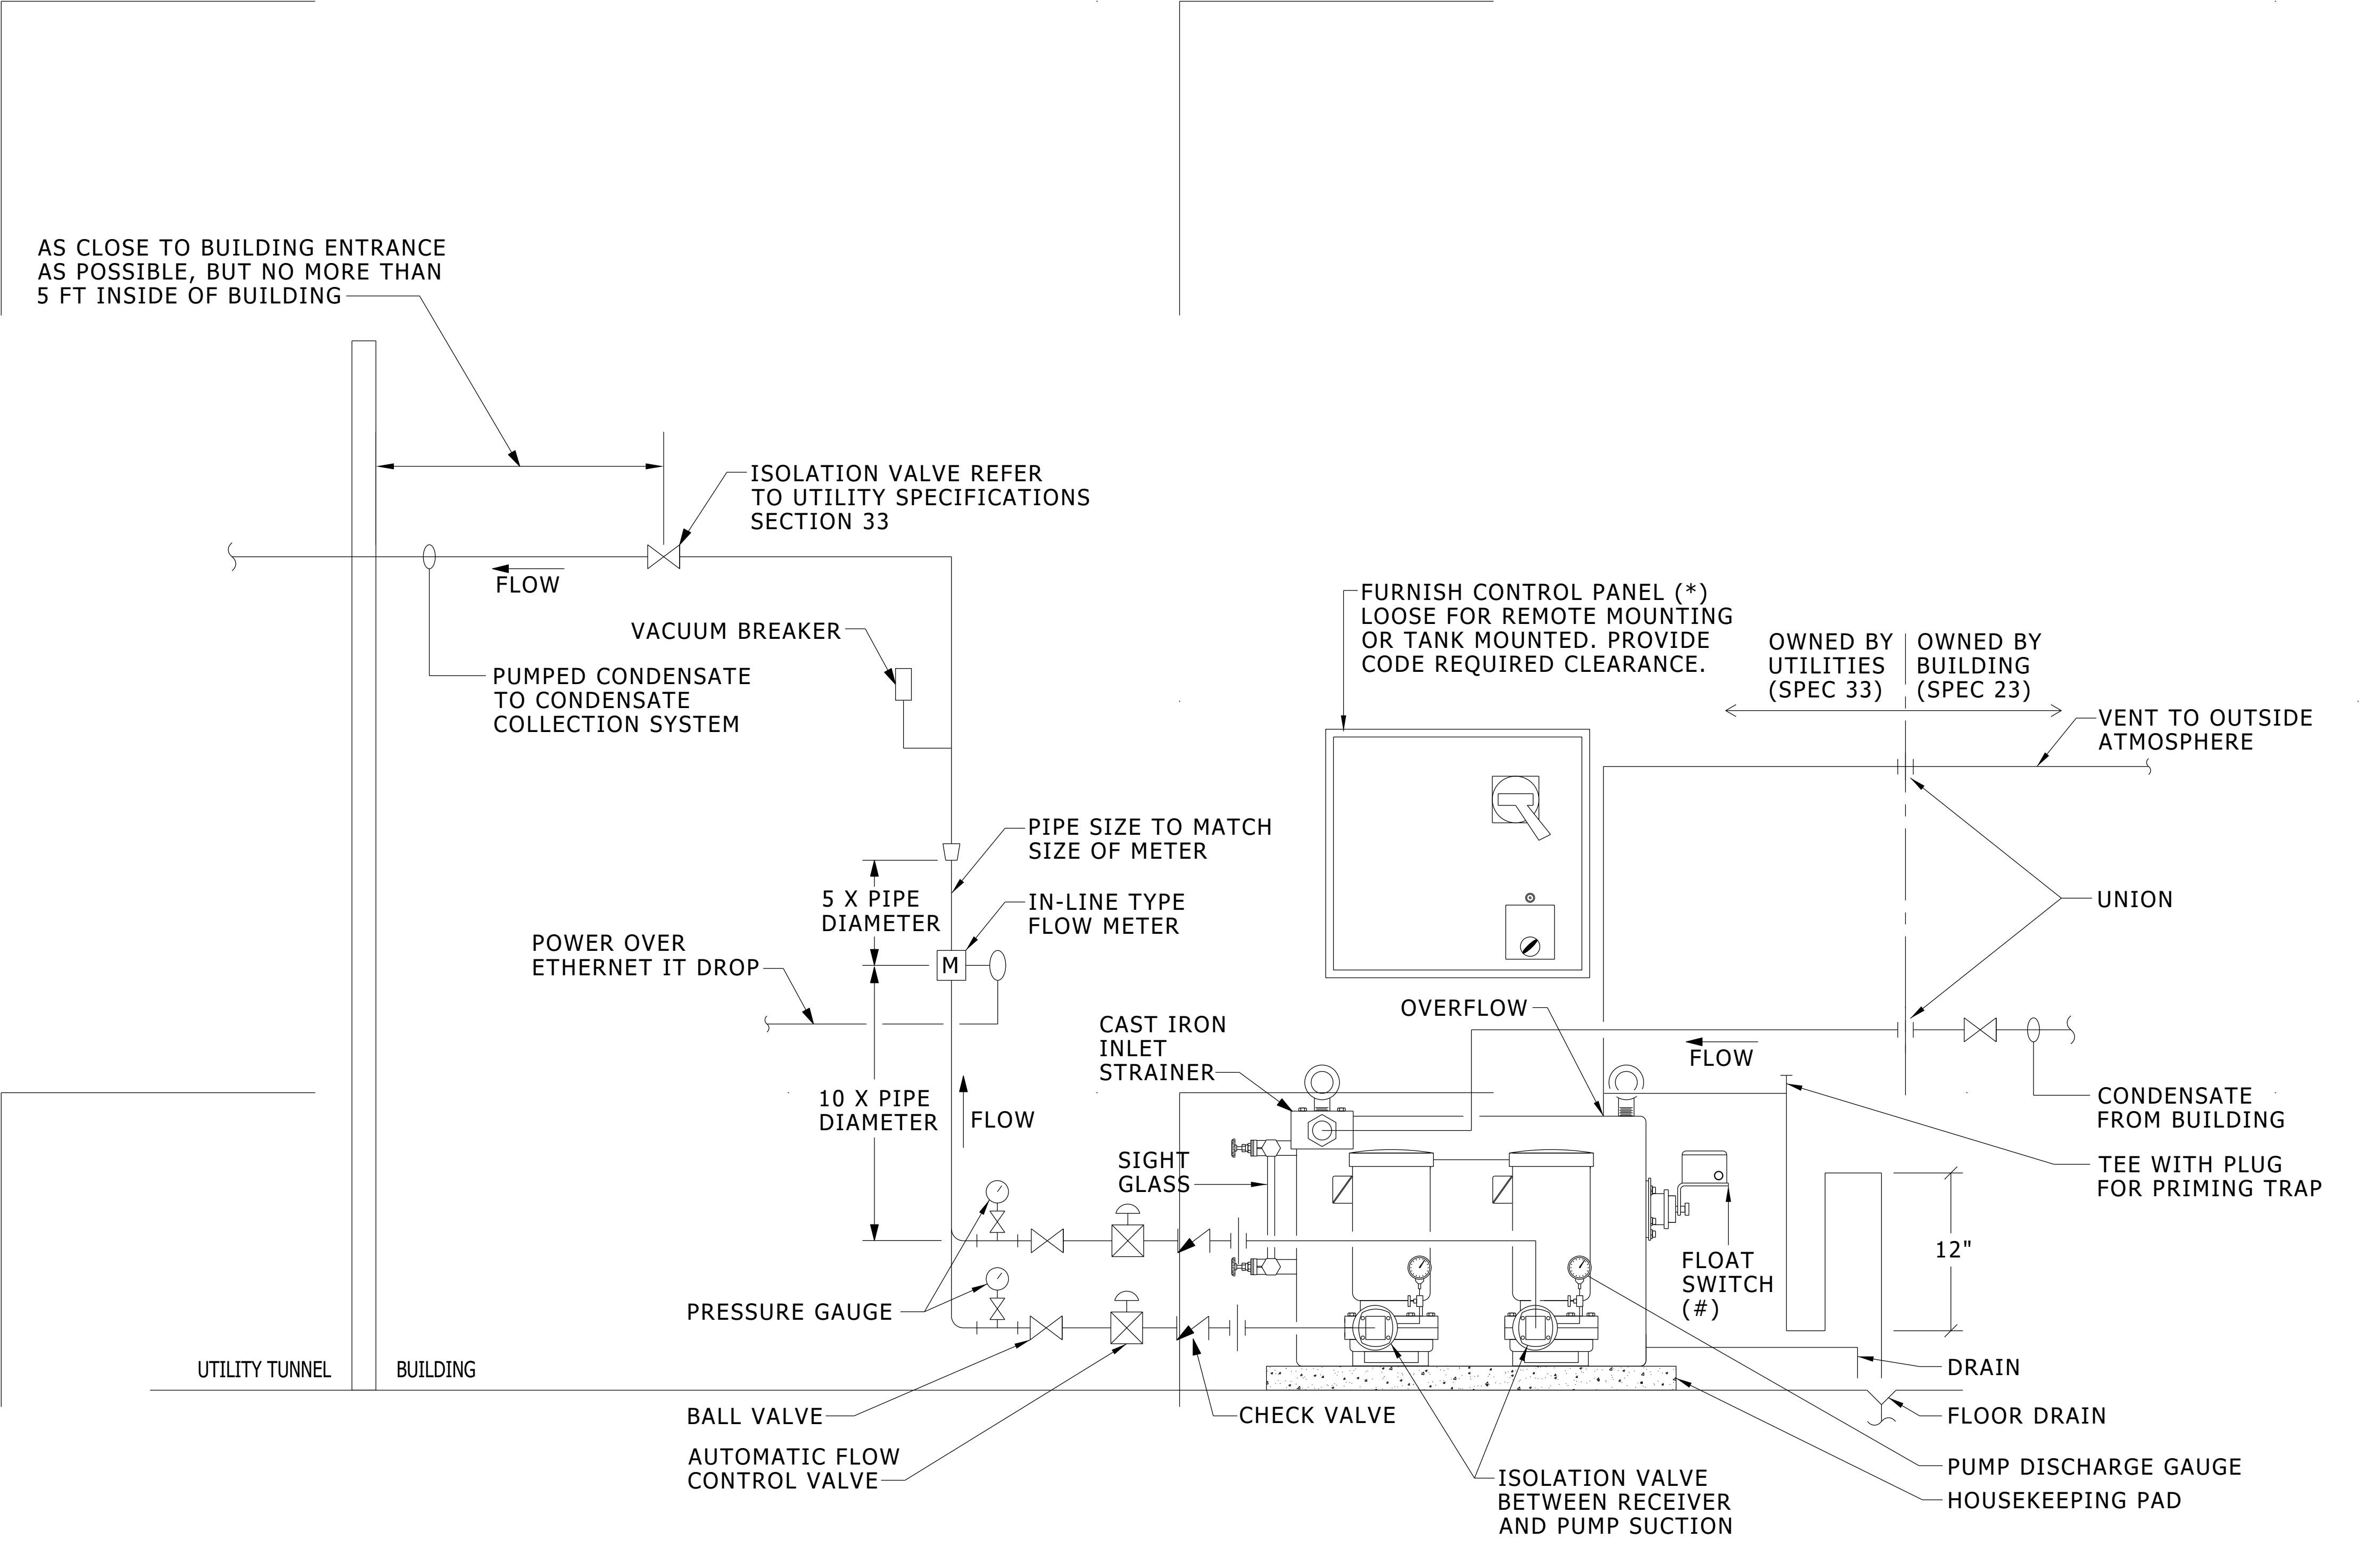

- NOTE:
- 1. ALL BUILDING OWNED (DIVISION 23) CRU MUST DISCHARGE TO A COMMON (UTILITY OWNED) CRU BEFORE BEING DISCHARGED TO CONDENSATE COLLECTION SYSTEM (UTILITY OWNED).
 - 2. UTILITY OWNED CRU TO BE LOCATED AS CLOSE AS POSSIBLE TO UTILITY STEAM/CONDENSATE ENTRANCE INTO BUILDING.
 - 3. CRU IS TO BE PROVIDED WITH INTEGRAL TEMPERATURE SENSOR.
 - 4. METER MUST STAY FLOODED AT ALL TIMES.
 - 5. STRAIGHT PIPE LENGTHS INDICATED ARE MINIMUMS.
 - 6. REFER TO MANUFACTURER'S INSTALLATION MANUAL FOR INSTALLATION INSTRUCTIONS AND ADDITIONAL REQUIREMENTS.
 - 7. REFER TO UTILITY SPECIFICATION SECTION 33 FOR ALL PIPE MATERIAL AND INSULATION REQUIREMENTS.

UTILITY MAINTAINED - FLOOR MOUNTED BUILDING CONDENSATE
RETURN UNIT DETAIL WITH CONDENSATE METERING

NO SCALE

MD 336333 003 2025-XX-XX

DESIGNER NOTES:

- 1. XXX