


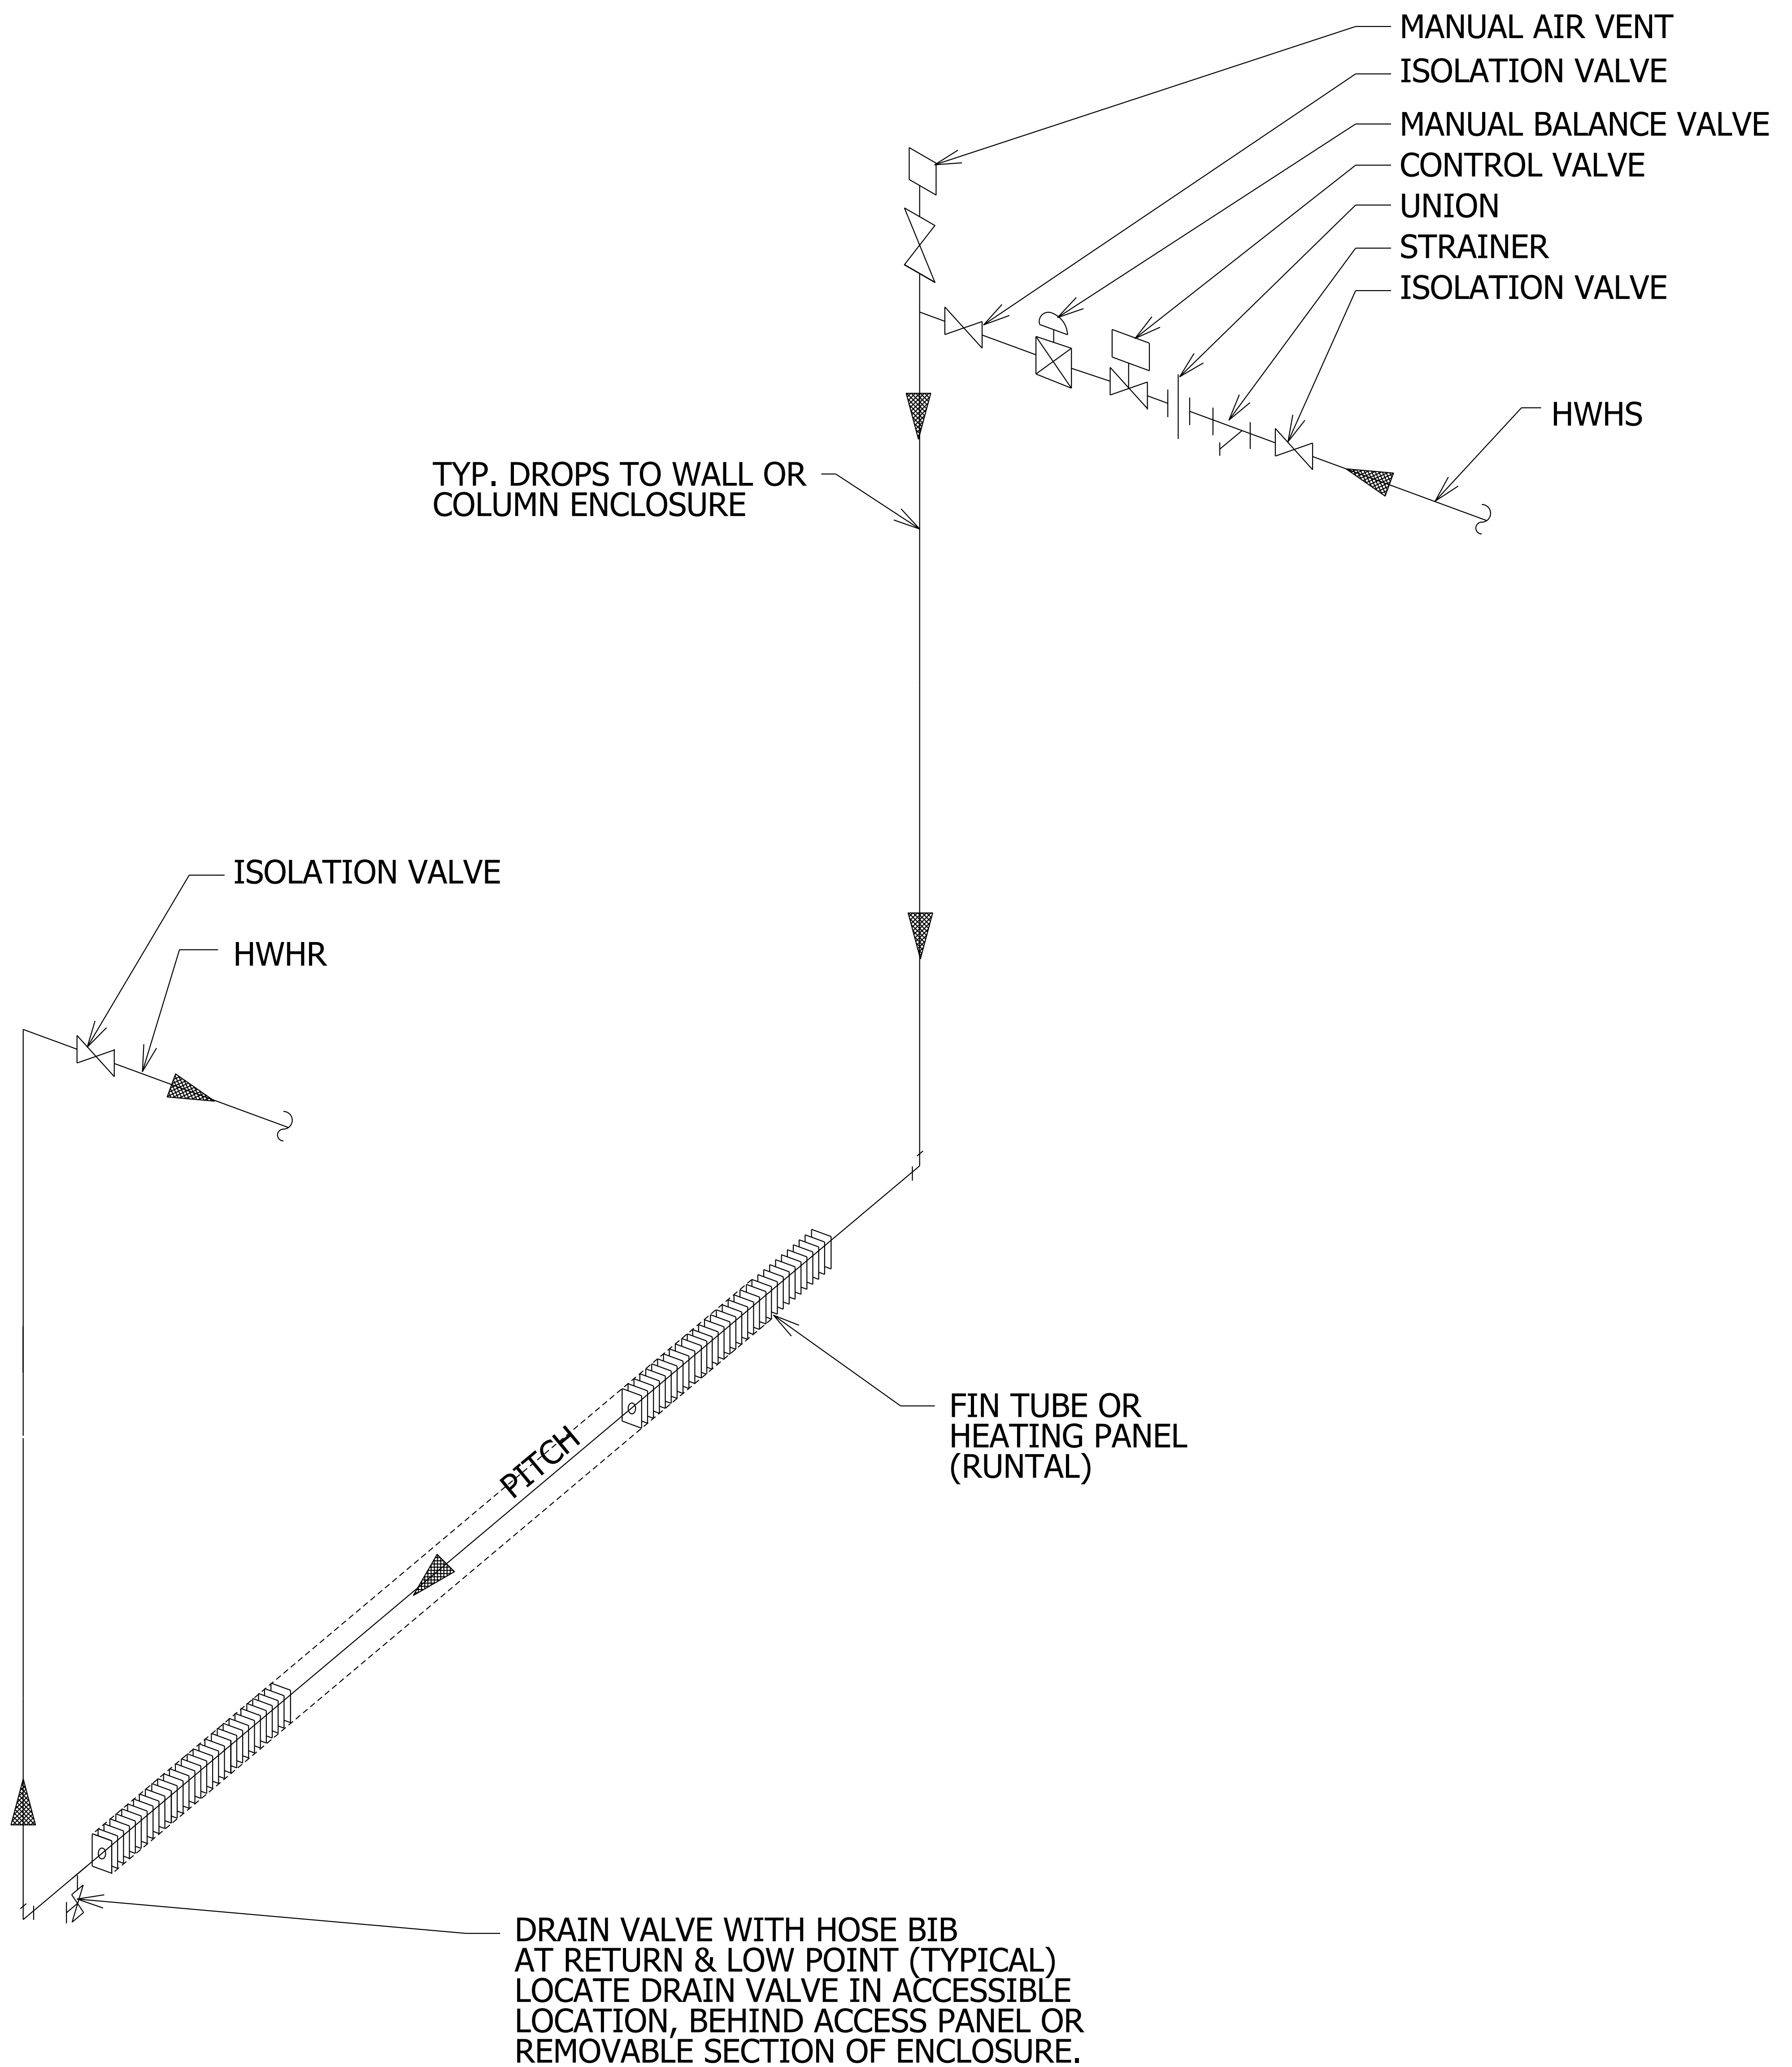

NOTES:

PROVIDE THREADED ADAPTERS AND REDUCERS AS NEEDED TO MAKE CONNECTIONS.

LOCATE STRAINER, CONTROL VALVE AND BALANCE VALVE IN ACCESSIBLE LOCATION AS CLOSE AS POSSIBLE TO FIN TUBE/HEATING PANEL SECTION SERVED.

COORDINATE FIN TUBE PIPING WITH FIN TUBE ENCLOSURE.

DOWN-FEED HOT WATER FIN-TUBE/HEATING PANEL (RUNTAL) PIPING DETAIL

X

MX.X

NO SCALE

MD 233660 012 10 28 20.dgn