


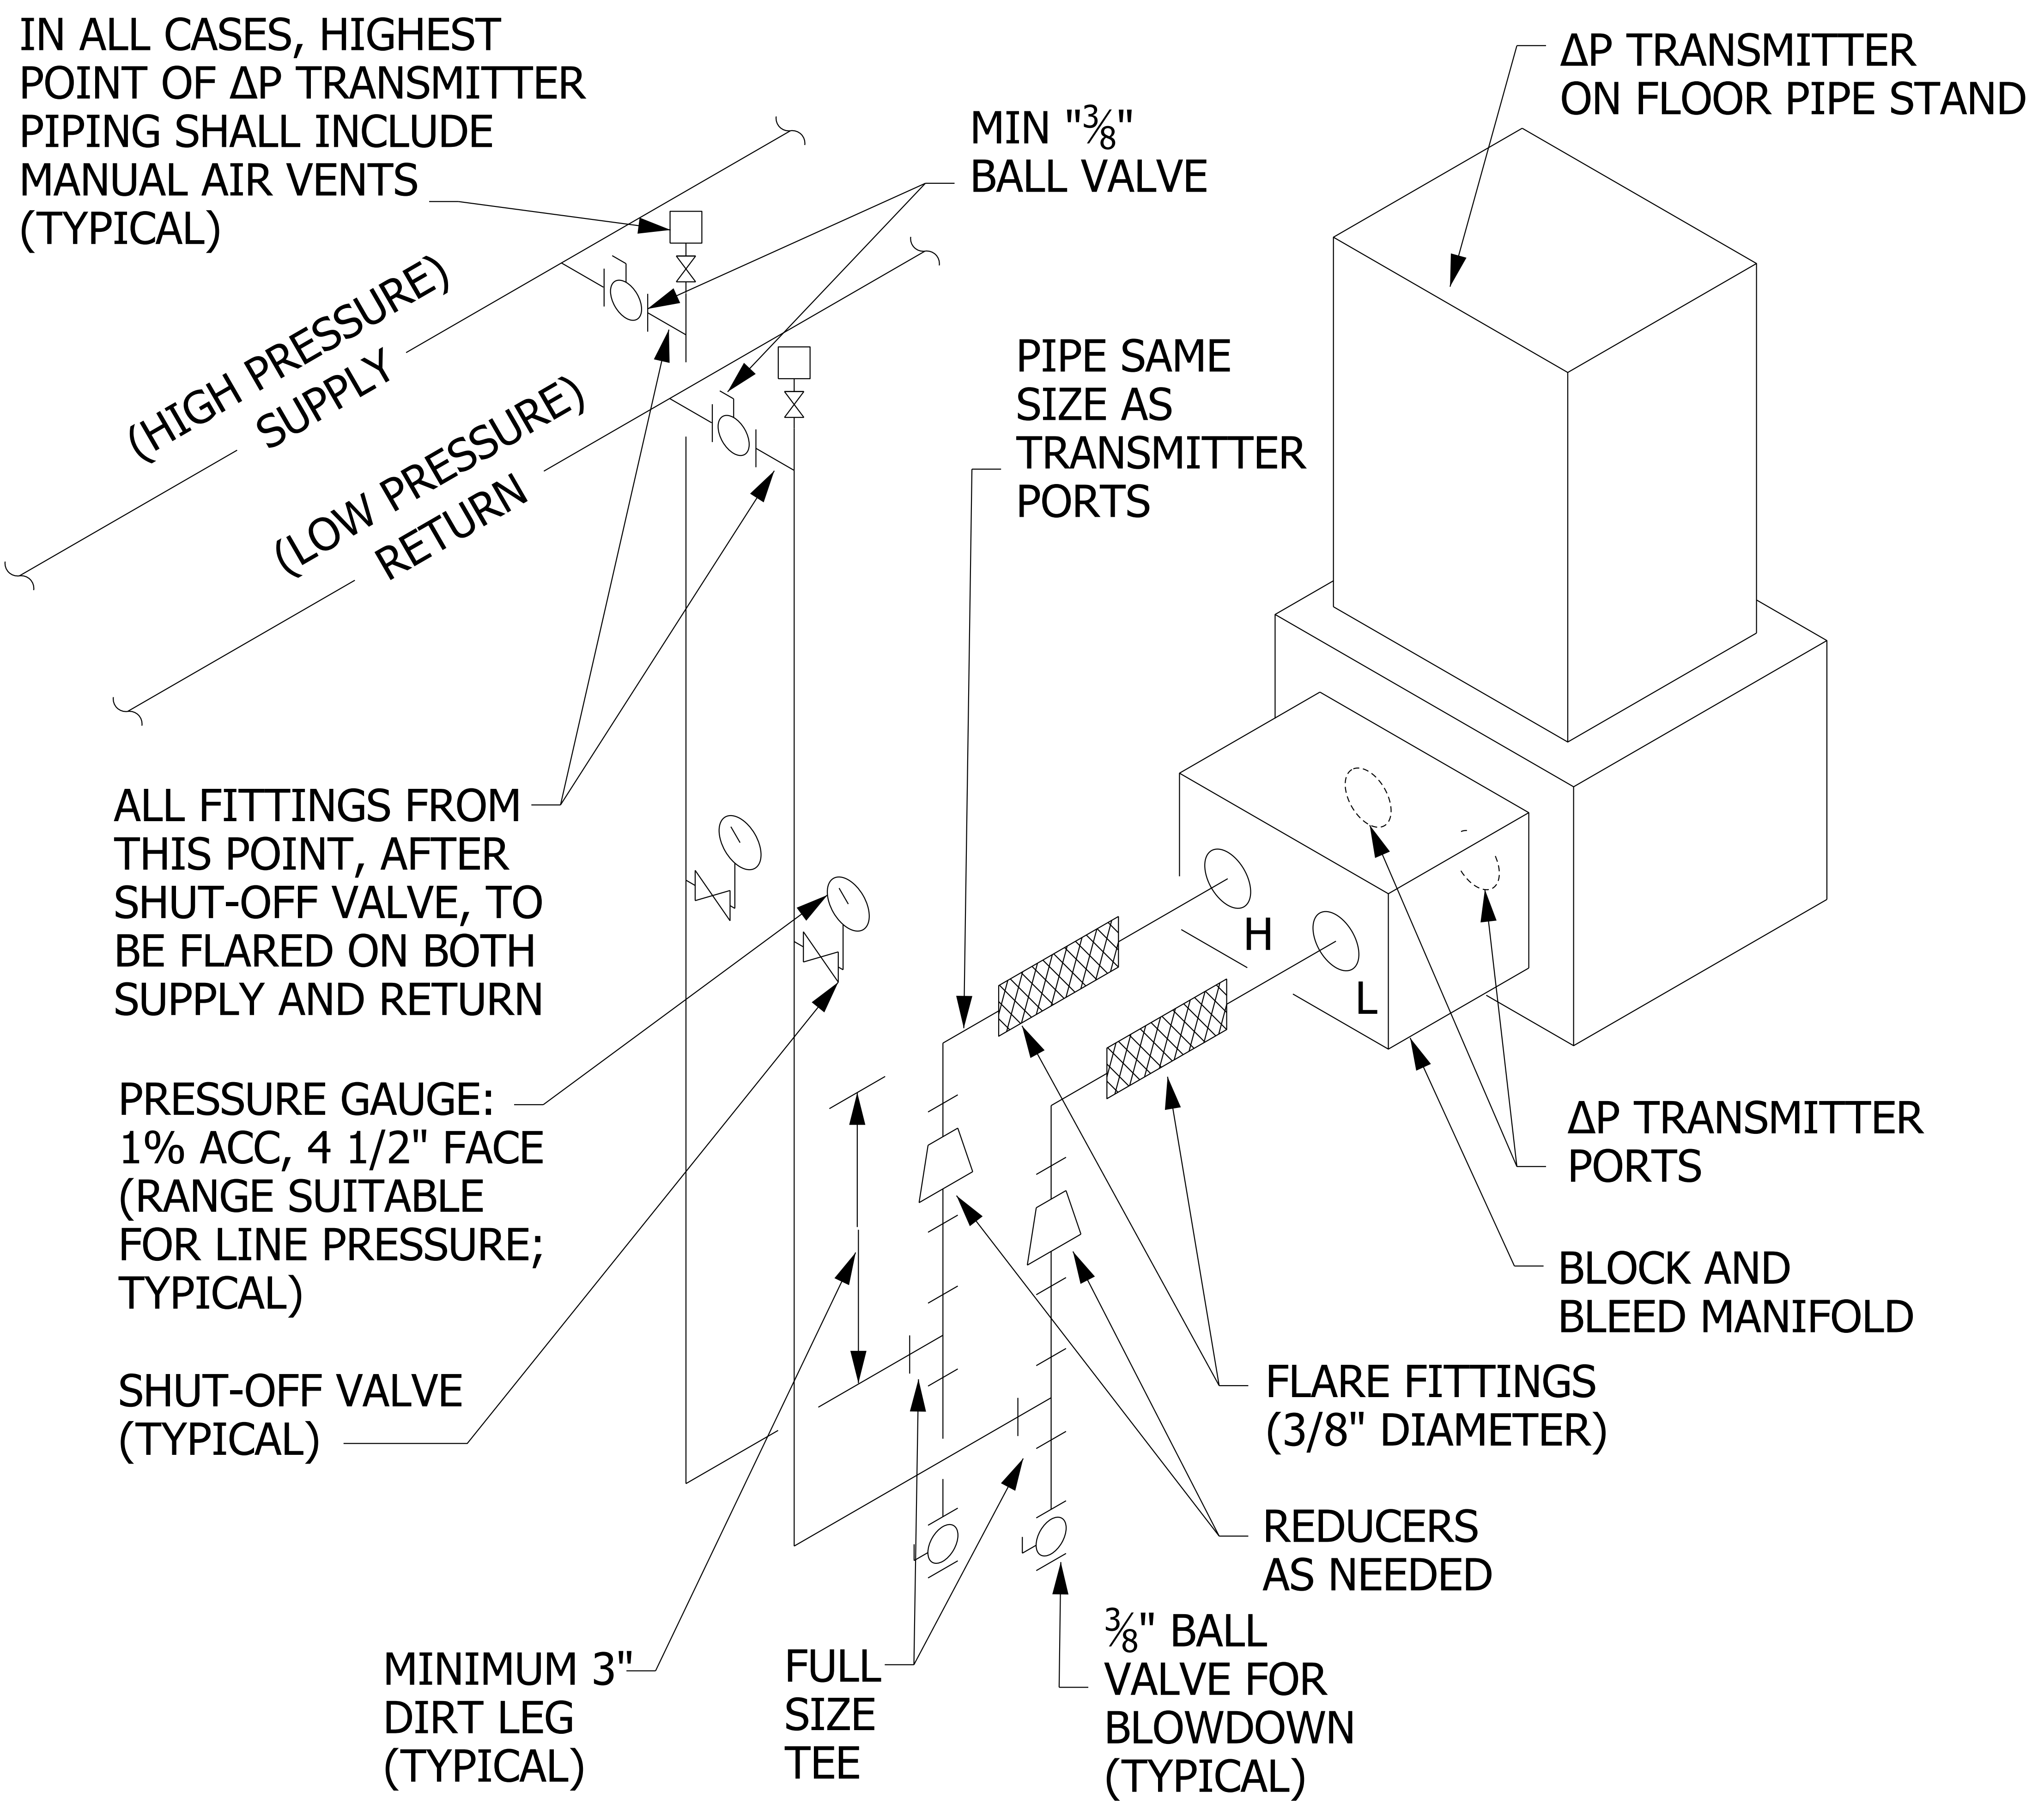

- NOTE:
- 1. ALL PIPING SIZE IS 3/8" DIAMETER MINIMUM.
 - 2. ALL INSTRUMENTATION PIPING TO BE FURNISHED AND INSTALLED BY CONTROLS CONTRACTOR

DIFFERENTIAL PRESSURE TRANSMITTER INSTALLATION DETAIL