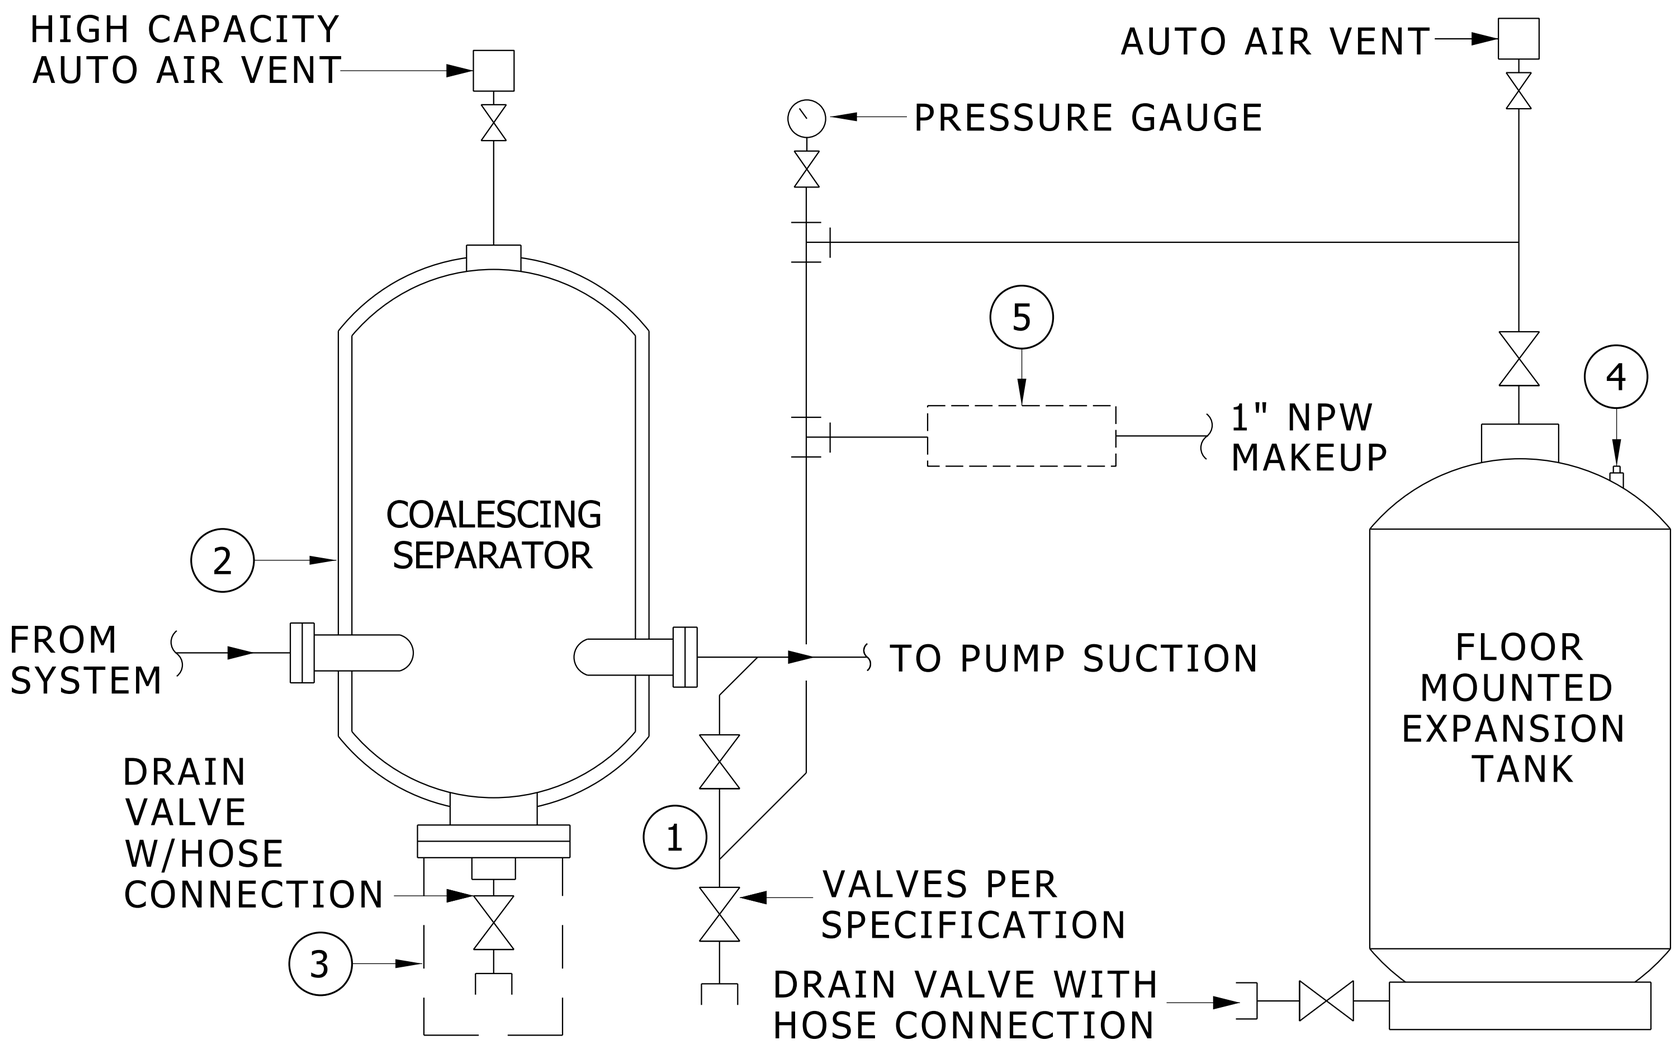


KEY NOTES

1. CONNECT TO SIDE OF MAIN. PROVIDE ANTI-THERMO SIPHON LOOP. ROUTE PIPING AS SHOWN.
2. INSULATE PER SPECIFICATIONS.
3. PROVIDE ROOM FOR SCREEN REMOVAL.
4. SET PRECHARGE TANK PRESSURE TO ___ PSIG.
5. MAKE-UP ASSEMBLY, SEE CLOSED SYSTEM MAKE-UP DETAIL. SET PRV TO__PSIG.
6. ESTIMATED SYSTEM VOLUME IS ___GALLONS.
7. ROUTE DISCHARGE OF AUTOMATIC AIR VENTS TO FLOOR DRAINS.

COALESCING SEPARATOR AND FLOOR MOUNTED EXPANSION TANK DETAIL

NO SCALE

D 15515 011 11 12.dgn

S:\Project Support\Details\M ech\15515 Hydronic Piping Systems\D 15515 011 11 12.dgn
carlosw
11/1/2012 1:30:17 PM

REFERENCED DETAILS/SCHEDULES:
XXXX S 15515 001 05 04

ADDITIONAL INFORMATION:

MODULES: X

THE UNIVERSITY OF MICHIGAN
PLANT EXTENSION
ARCHITECTURE, ENGINEERING & CONSTRUCTION
ARCHITECTURAL AND
ENGINEERING SERVICES
326 EAST HOOVER STREET
ANN ARBOR, MI 48109-1002

Coalescing Separator and Flr. Mtd. Expans. Tk. Detail

DIVISION: 15
SECTION: 15515
FILE: D 15515 011 11 12.dgn
ISSUE DATE: 11/01/12